


NOTES

1. PUMP CONNECTION SHALL HAVE BAUER FLANGE X-BALL QUICK DISCONNECT COUPLING PART NO. 100-7005 OR APPROVED EQUAL.

2. ALL PIPE AND FITTINGS TO BE LINED WITH PROTECTO 401 OR AN APPROVED EQUAL.

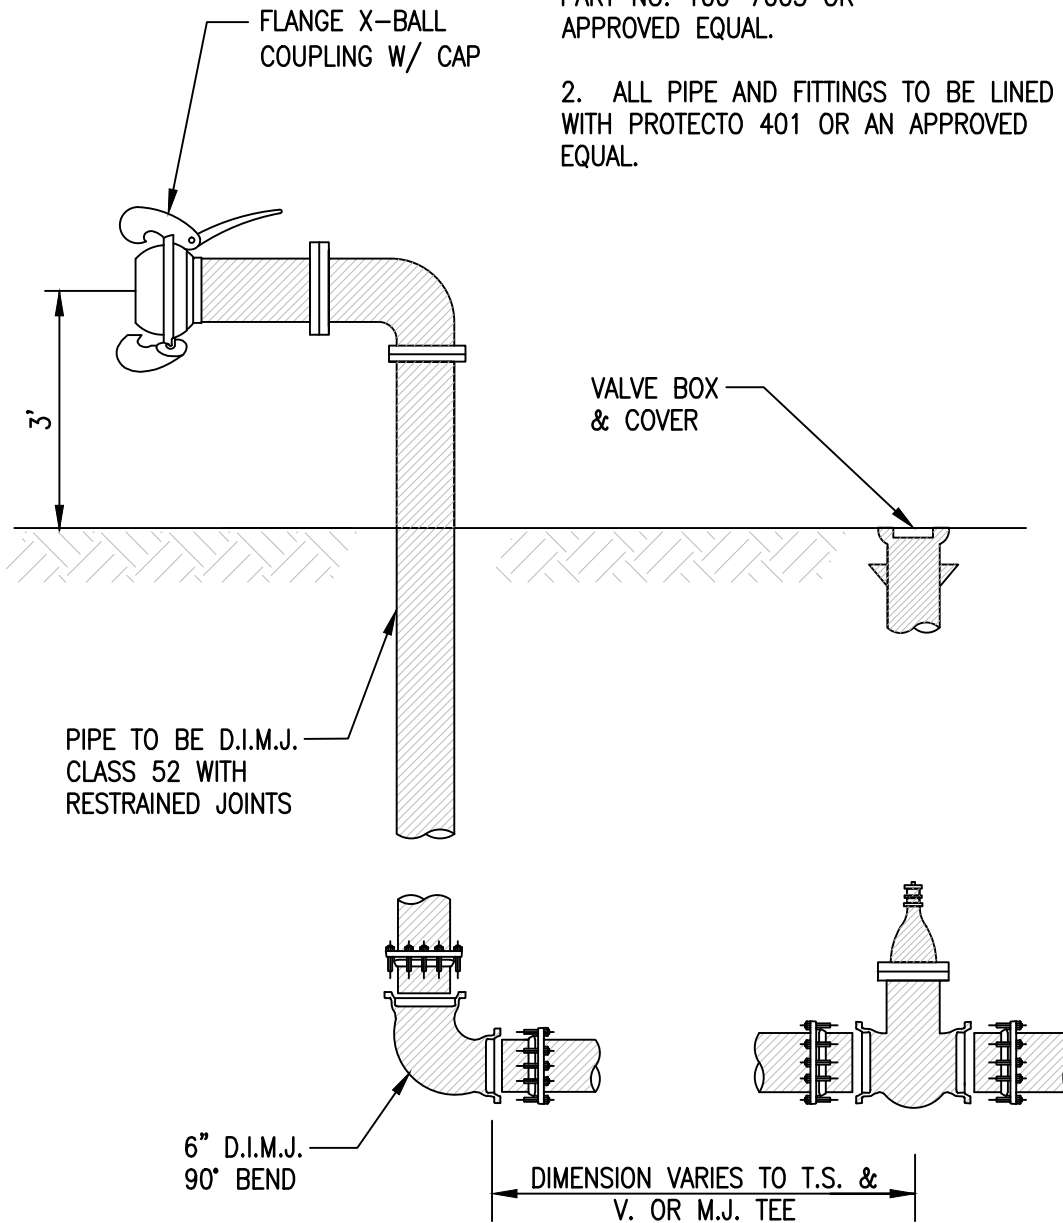

CITY OF NORFOLK – DEPARTMENT OF UTILITIES  
STANDARD DETAILS

SCALE:  
NOT TO SCALE

EMERGENCY PUMP CONNECTION

DRAWING NO.  
CS 13

DATE: 03/07